




REAR ELEVATION

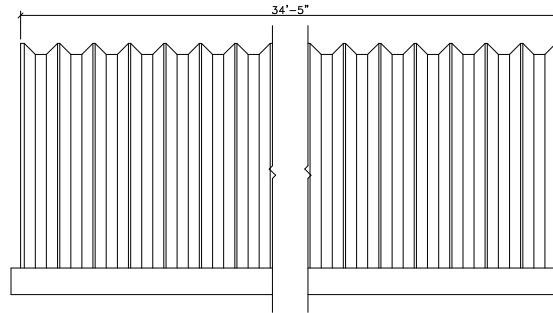


SIDE ELEVATION

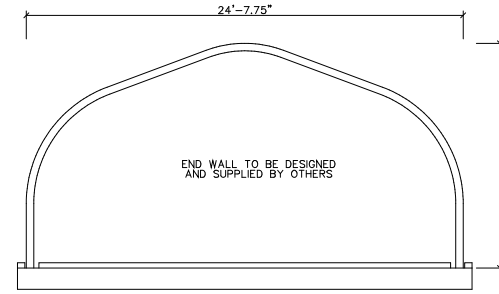

FRONT ELEVATION

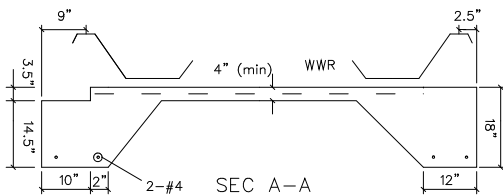


SEC A-A

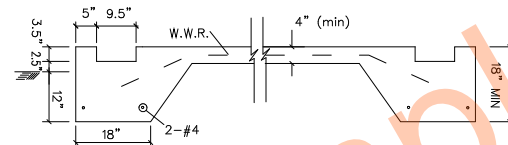


SEC B-B

WARNING: DO NOT REMOVE OR REDUCE THE CONCRETE FLOOR OR THE REINFORCING STEEL, AND/OR RAISE THE TOPS OF THE FOOTERS ABOVE THE FLOOR OR BUILDING FAILURE MAY RESULT

- Minimum Concrete Cover:
- (a) Concrete Cast against earth: 3"
 - (b) Concrete exposed to earth or weather: No. 6 through No. 10 bars: 1.5"
No. 5 bar and smaller: 0.75"
 - (c) Concrete not exposed to earth or weather: 0.75"

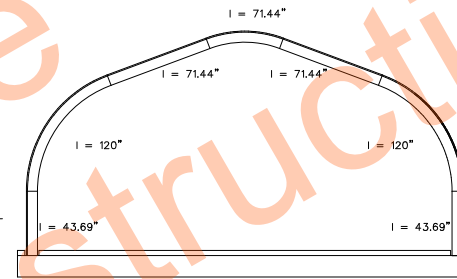


ARCH PROFILE

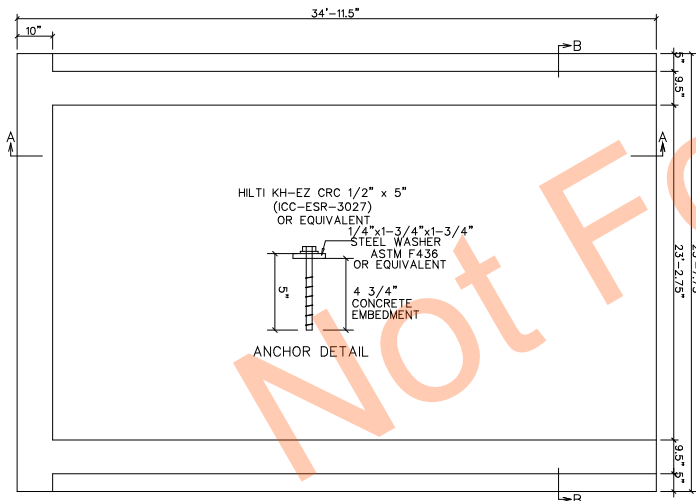


FOUNDATION PLAN

ARCH ANCHORAGE

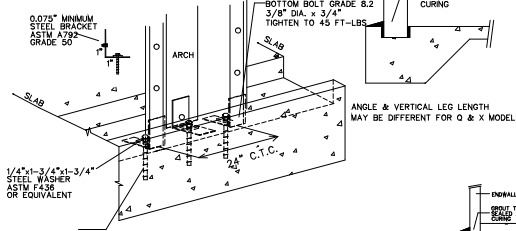

FIRST ANCHOR BOLT LOCATION FROM END OF FOUNDATION:
 * SOLID ENDWALL = 5" FROM BUILDING CENTERLINE, THEN 18" C.T.C.
 * OPENING ENDWALL = 2" FROM DOOR FRAME OPENING, THEN 18" C.T.C.

ENDWALL ANCHORAGE


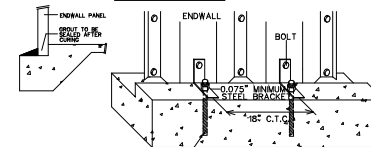


ANCHOR LOCATIONS:
 * SOLID ENDWALL = 5" FROM BUILDING CENTERLINE, THEN 18" C.T.C.
 * OPENING ENDWALL = 2" FROM DOOR FRAME OPENING, THEN 18" C.T.C.

- GENERAL NOTES**
1. ALL MATERIAL AND WORKMANSHIP SHALL CONFORM WITH THE REQUIREMENTS OF THE LATEST REVISION OF THE INTERNATIONAL BUILDING CODE 2006. DESIGN ACCORDING TO NASPIRC-01, NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS, AND WITH ANSI/ASCE 7-05.
 2. NO LOADS OTHER THAN THOSE GIVEN UNDER "DESIGN DATA" BELOW SHALL BE IMPOSED ON THE "STRUCTURE".
 3. SPECIFIC NOTES AND DETAILS SHOWN ON THE DRAWINGS SHALL TAKE PRECEDENCE OVER THE BUILDING MANUAL SUPPLIED.
 4. THE BUILDING, INCLUDING THE FOUNDATION, MUST BE CONSTRUCTED IN STRICT ACCORDANCE WITH THE DRAWING AND ERECTION INSTRUCTIONS. ANY DEVIATION UNLESS APPROVED BY US IN WRITING, SHALL NULLIFY OUR CERTIFICATE AND SEAL AND SHALL BE THE SOLE RESPONSIBILITY OF THE ERECTOR.
 5. A PROFESSIONAL ENGINEER SHOULD BE RETAINED WHERE SITE INSPECTIONS ARE WARRANTED.
 6. NO ARCH PANEL MAY BE CUT OR MODIFIED UNLESS IT IS TO ACCOMMODATE AN ACCESSORY PROVIDED BY THE MANUFACTURER IN ACCORDANCE WITH ITS INSTRUCTIONS AND/OR THIS DRAWING.
 7. MINIMUM SEPARATION FROM THIS BUILDING TO ANY TALLER BUILDING MUST BE THE SMALLER OF 20 FEET AND 6 TIMES THE HEIGHT DIFFERENCE.
 8. IF SEALED BY AN ENGINEER, THIS DRAWING IS FOR PERMIT APPLICATION. OTHERWISE IT IS A DRAFT AND NOT FOR CONSTRUCTION.

- FOUNDATION NOTES**
- NOTE: THE FOUNDATION ON THE DRAWING SPECIFIES THE MINIMUM REQUIREMENTS. LOCAL BUILDING CODE AND SITE CONDITIONS MAY REQUIRE A STRONGER FOUNDATION, WHICH MUST BE DESIGNED BY A LOCAL ENGINEER.
1. THE FOUNDATION SHALL BE FOUNDED ON NATURAL UNDISTURBED SOIL CAPABLE OF SAFELY SUSTAINING 1500 psf. THIS SHALL BE DESIGNED TO FULLY RESIST ALL ROTATION AT THE BASE OF THE ARCH.
 2. SLAB ON GRADE SHALL BE PLACED ON WELL COMPACTED SOIL CAPABLE OF SUSTAINING 1500 psf WITHOUT APPRECIABLE SETTLEMENT.

- DESIGN DATA (MATERIALS)**
1. CONCRETE $f'_c = 2500$ PSI @ 28 DAYS, ACI
 2. REINFORCING STEEL GRADE 40, $F_y = 40$ KSI, ASTM A615
 3. W.W.R. $F_y = 65$ KSI, ASTM A185
 4. W.W.R. $6 \times 6 = W14 \times W14$



BOLTS: SAE GRADE 2 OR ASTM A307
 ARCH STEEL THICKNESS - SEE ARCH PROFILE
 ENDWALL STEEL THICKNESS = 0.03 in.

GALVALUM	92-03
STRUCTU	
55% ALU	
ASTM A7	
50 KSI W	
65 KSI W	
HSS SEC	
AST	
W SECTP	
AST	
OTHER S	
AST	
ARCH DES	ASCE 7-05:
Loc: ROOF	
Pg: GROUND	
Cat: EXPOS	
Ctl: THERM	
IMPORTAN	
CATEGORY	
Prnts: COM	0
V: BASIC	
Klx: VELOC	
Ggp: PRO	
AND	
Kst: WIND	
Kst: TOPO	
IMPORTAN	
WIND EXPC	
SEISMIC D:	

LEGAL NOTE
 This drawing is the property of Future Steel Buildings Int'l. Corp. Any duplication of this drawing in whole or in part is strictly forbidden. Anyone doing so will be prosecuted under the full extent of the law.

REVISE:	
DESIGNED BY:	
APPROVED BY:	
SCALE:	
DATE:	
PROJECT:	
NO:	

Future Steel Buildings Int'l. Corp.	
220 Chrysler Drive, Brampton, Ontario, Canada, L6S 6B6, Phone: (905) 790-8500	
SCALE:	AS SHOWN
DATE:	2024-0-28
PROJECT:	
NO:	A25-13